


Door Number	Type	DOOR					Fire Rating	Hardware	FRAME			Comments
		Width	Height	Thickness	Material	Finish			Type	Material	Finish	
3	C	12' - 0"	12' - 0"	0' - 2"	STEEL	PREFINISHED			STEEL		NIC	
4	C	12' - 0"	12' - 0"	0' - 2"	STEEL	PREFINISHED			STEEL		NIC	
2	B	4' - 0"	7' - 0"	0' - 1-3/4"	STEEL	PAINTED		ALLOWANCE ITEM HG2	A	STEEL	PAINTED	INSULATED
1	A	3' - 0"	7' - 0"	0' - 1-3/4"	STEEL	PAINTED		ALLOWANCE ITEM HG1	A	STEEL	PAINTED	INSULATED

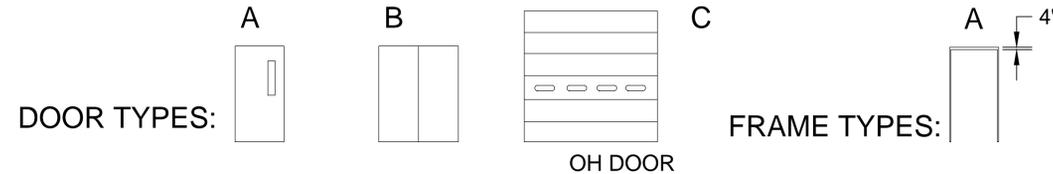

ABBREVIATIONS

- C.O. CLEAN-OUT
- DS DOWNSPOUT
- FD FLOOR DRAIN
- FE FIRE EXTINGUISHER (ALLOWANCE ITEM)
- HB HOSE BIBB
- SD SOAP DISPENSER (ALLOWANCE ITEM)
- TD TOWEL DISPENSER (ALLOWANCE ITEM)
- NIC NOT IN CONTRACT

SIGNAGE (ALLOWANCE ITEMS)


- S1 ENTRANCE ONLY (EAST OF DOOR #4)
- S2 EXIT ONLY (EAST OF DOOR #3)
- S3 AUTHORIZED PERSONNEL ONLY (DOOR #1)
- S4 DE-ICER FILL CLOSET, DOORS TO REMAIN CLOSED WHEN NOT IN USE (DOOR #2)

EXERIOR CONCRETE SLAB NOTES


1. EXTERIOR APRON OR STOOP SHALL BE 5" CONCRETE SLAB W/ #6 R/F @ 36" O.C., OR 3 MIN. & 6X6X2.9 WWF, ON 12" GRAVEL.
2. REINFORCEMENT (R/F) & WWF SHALL BE EPOXY COATED.
3. CONCRETE FINISH SHALL BE LIGHT BROOM ACROSS TRAFFIC, W/ 2 COATS OF CURING SEALER.
4. PROVIDE CONTROL JOINT @ 10' O.C.
5. PROVIDE 1/2" JOINT & FILLER WHERE SLAB ABUTTS WALLS OR OTHER CONCRETE PAVEMENT, EXCEPT WHERE NOTED OTHERWISE

ROOM FINISHING & MATERIALS NOTES

1. TRITURATION ROOM FLOOR FINISHES: 3 COATS OF WATER BORN POLYURETHANE CONCRETE SEALER OVER BARE CONCRETE SURFACE. FRESH CONCRETE SHALL BE LIGHT BROOM OR WOOD TROWEL FINISHED AS DETERMINED BY OWNER, AND AIR CURED WITH SHEET PLASTIC COVER FOR A MINIMUM OF 7 DAYS FOR CURING WITH ADDITIONAL DURATION FOR GENERAL PROTECTION AS RE'D. DO NOT COAT FRESH CONCRETE WITH CURING SEALER. APPLY FINISH COATINGS AFTER CONCRETE HAS CURED FOR A MINIMUM OF 28 DAYS.
2. GRINDER PIT, SPILL CROCK, HOSE CLOSET FLOOR FINISH: EPOXY COATING IN ABRASIVE FINISH.
3. CMU WALL INTERIOR SURFACES - LOWER 18" : EPOXY COATING IN SMOOTH FINISH.
4. CMU WALL INTERIOR SURFACES 18" AND ABOVE: CLEAR SILICON MASORNY SEALER.
5. EXPOSED MISC METAL | CLOSURE PLATE, LIGHT GAUGE ANGLES, FASTENERS ETC: GALVANIZED.

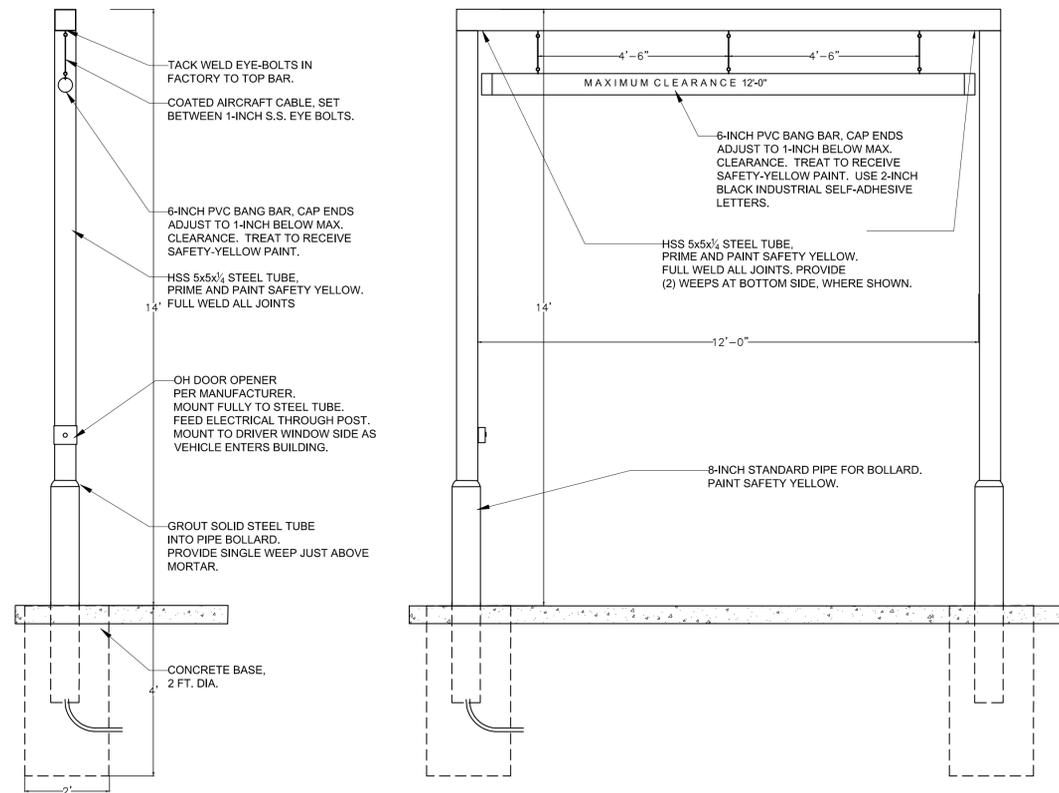

2 A1 TRUCK CLEARANCE STRUCTURE
1/2" = 1'-0"

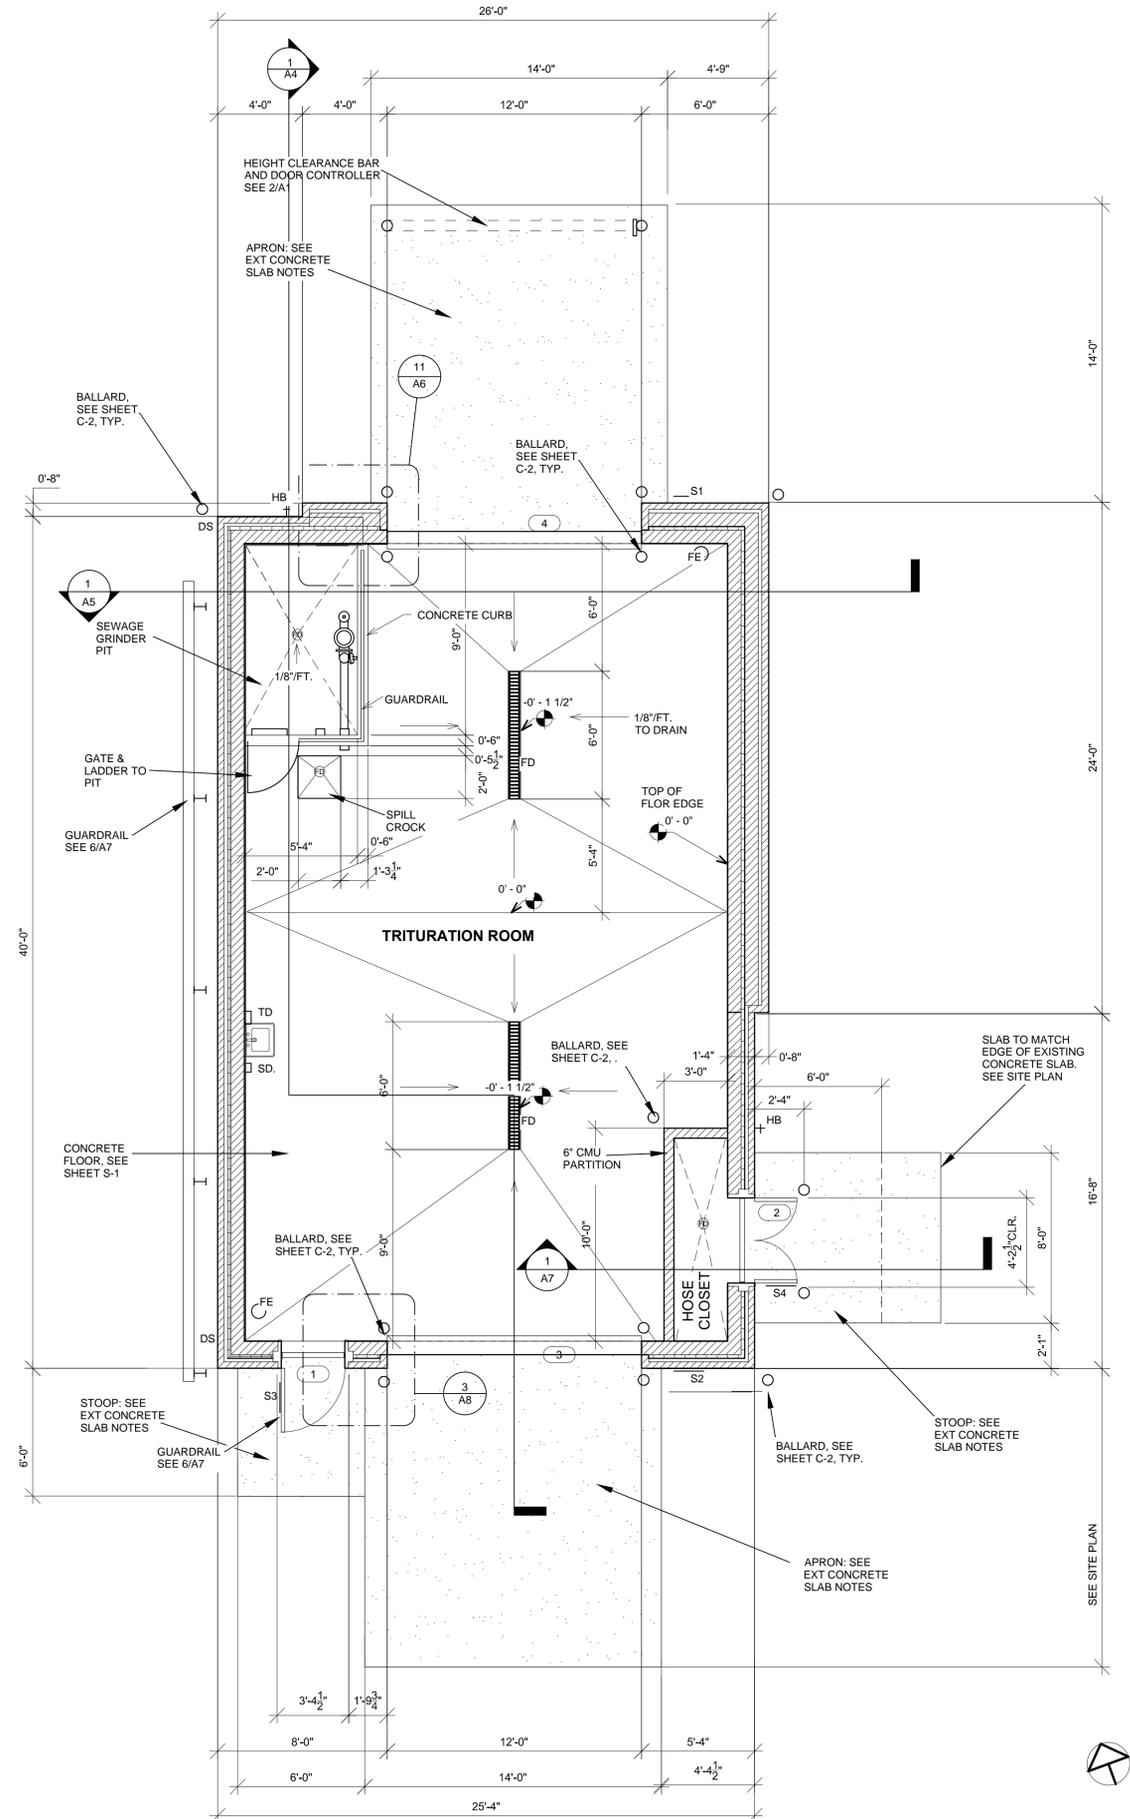

1 A1 GROUND FLOOR PLAN
1/4" = 1'-0"



REVISIONS:

DATE: 6-30-2010
PROJECT NO: A104 - 08454
SITE NO: 290
BUILDING NO: 252